



Surge Protective Device

WTH-20/D/R Series	
Paperless Datasheet	01
Model & Ordering Code	01
Certificates of Products	01
More Package	02
Technical Data	03
Surge Protection Connection Diagram	04
Dimensions	04
Remote Contacts (Dry Contacts)	05
Fault Indication	05
Common Terms and Definitions	06
How to choose a suitable Uc(MCOV) value	06
AC Network Connection Diagram	07
Difference mode & Common mode Connection Diagram	08
Selection of back-up fuse	09
Selection of back-up circuit-breaker	09
Application	10
N-PE Module	11
3P + NPE Combintion Package	11
1P + NPE Combintion Package	11
FAQ & Help	12
Download WatchfulEyE Official App	13
After-sale Services	13
I have a question	13



Surge Protective Device

Paperless Datasheet

Going green and protecting environment is manufacturers' responsibility. Each WatchfulEyE product has a link of downloading data sheet on its enclosure:

<http://datasheet.watchfuleyesolutions.com/US220194.html>

3D file download

http://www.watchfuleyesolutions.com/wth_rar/3D/24WTH40-1P-18.stp.zip

Model & Ordering Code

Model	Ordering Code	MCOV/Uc	Remote Contacts	UPC/EAN Code
WTH-20/D/R/1P-275	US220194	275VAC	YES	(0) 811914031352
WTH-20/D/1P-275	US220184		NO	(0) 811914031413
WTH-20/D/R/1P-320	US220195	320VAC	YES	(0) 811914031369
WTH-20/D/1P-320	US220185		NO	(0) 811914031420
WTH-20/D/R/1P-385	US220196	385VAC	YES	(0) 811914031376
WTH-20/D/1P-385	US220186		NO	(0) 811914031437
WTH-20/D/R/1P-420	US220197	420VAC	YES	(0) 811914031383
WTH-20/D/1P-420	US220187		NO	(0) 811914031444



Certificates of Products



IEC61643-11



Surge Protective Device

More Package

Model with suffix	WTH-20/D/R/1P-275	x2pcs	x3pcs	x4pcs
Ordering Code	US220194	US220194x2	US220194x3	US220194x4

Model with suffix	WTH-20/D/1P-275	x2pcs	x3pcs	x4pcs
Ordering Code	US220184	US220184x2	US220184x3	US220184x4

Model with suffix	WTH-20/D/R/1P-320	x2pcs	x3pcs	x4pcs
Ordering Code	US220195	US220195x2	US220195x3	US220195x4

Model with suffix	WTH-20/D/1P-320	x2pcs	x3pcs	x4pcs
Ordering Code	US220185	US220185x2	US220185x3	US220185x4

Model with suffix	WTH-20/D/R/1P-385	x2pcs	x3pcs	x4pcs
Ordering Code	US220196	US220196x2	US220196x3	US220196x4

Model with suffix	WTH-20/D/1P-385	x2pcs	x3pcs	x4pcs
Ordering Code	US220186	US220186x2	US220186x3	US220186x4

Model with suffix	WTH-20/D/R/1P-420	x2pcs	x3pcs	x4pcs
Ordering Code	US220197	US220197x2	US220197x3	US220197x4

Model with suffix	WTH-20/D/1P-420	x2pcs	x3pcs	x4pcs
Ordering Code	US220187	US220187x2	US220187x3	US220187x4



Surge Protective Device


Description

In accordance with: IEC/EN61643-11 - Class III and UL1449 Type 4 Location
Location of use: branch sub-distribution boards
Plug-in module and separate base design enables convenient maintenance.
Internal thermal disconnect devices help ensure safe or at end-of-life

WTH-20/D/R/1P Series Technical Data


Requirement Class to IEC/EN61643-11	Class III
IEEE Category Rating	B & A
Nominal Discharge Current (In)	10kA
Max. Discharge Current (Imax)	20kA
Open circuit voltage (Uoc)	20kV
Protection Modes	L-PE, N-PE
Protective Element	MOV
Follow Current (If)	NO
Response Time (tA)	<5ns
Leakage Current (at 75%U1mA)	<20µA
Thermal Protection	YES
Protection Rating (IP Code)	IP 20
Short Circuit Current Ratings (SCCR)	25kA rms
Max. Back-up Fuse (if mains >50A)	50A gL (circuit-breaker: <20A)
Surge Life at 3kA (8/20µs)	>5000 events
Temperature Range	- 40°F to 176°F (-40°C to 80°C)
Relative Humidity	0% to 95% noncondensing
Maximum Operating Altitude	10,000 feet (3000m)
Terminal Cross Section	35mm ² (solid) / 25mm ² (stranded)
Stripping Length Contacts	0.6inches (15mm)
Terminal Screw Torque	Max. 3.5Nm
DIN Rail EN60715	35mm top-hat rail
Dimensions DIN 43880	18mm (1TE)
Housing Material	Thermoplastic (UL94 V-0)
Housing Design	Modular design
Net Weight Per Unit	0.3Lb (136g)

Surge Protection Connection Diagram

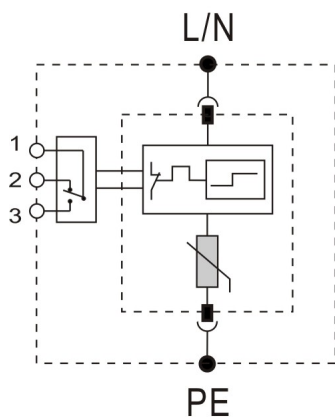


Maximum Continuous Operating Voltage (MCOV/Uc)	275VAC	320VAC	385VAC	420VAC
Voltage Protection Level (Up)	1.3kV	1.4kV	1.5kV	1.7kV
Residual Voltage (Ures)	1.0kV	1.1kV	1.2kV	1.4kV

Dimensions

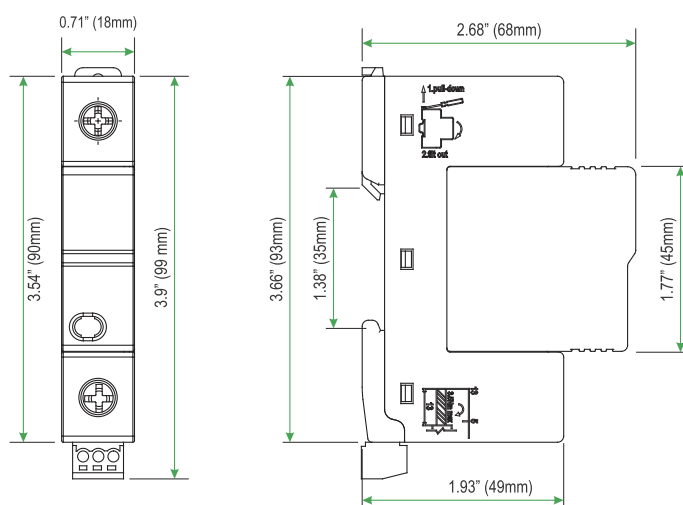


Remote Contacts (Dry Contacts)

- 1: COM (Common)
- 2: NC (Normally Close)
- 3: NO (Normally Open)

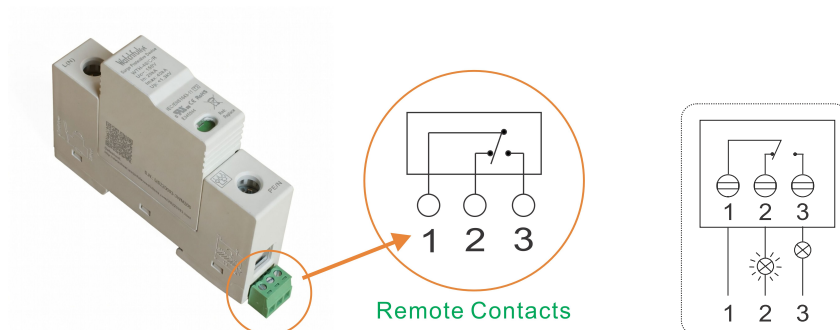

Contact Ratings	125VAC/3A, 250VAC/1.5A
Terminal Cross Section	Max. 1.5mm ²
Stripping Length Contacts	0.25 inches (6-7mm)
Remote Terminal Torque	0.25Nm

Fault Indication (same indication in 1P/2P/3P/4P/1P+NPE/3P+NPE models)

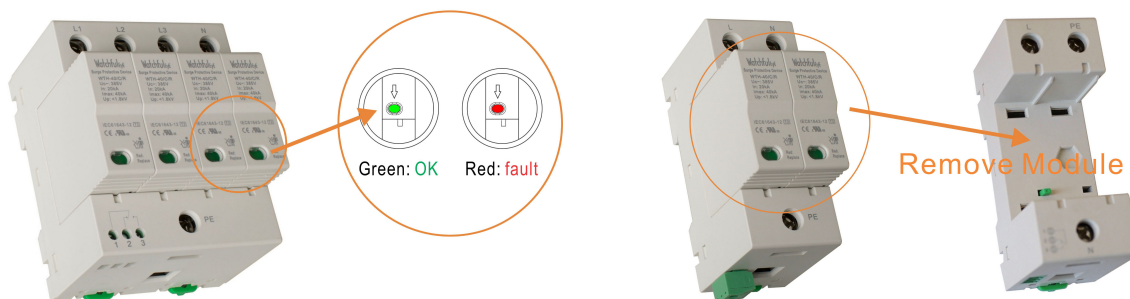

Common Terms and Definitions

1. Normal operating voltage rating (U_n)
2. Maximum Continuous Operating Voltage (U_c /MCOV):
Maximum r.m.s. voltage, which may be continuously applied to the surge protective device's mode of protection.
3. Nominal Discharge Current for Class II Test (I_n):
crest value of the current through the surge protective device having a current waveshape of 8/20 μ s.
4. Maximum Discharge Current (I_{max}):
Crest value of a current through the surge protective device having an 8/20 μ s waveshape and magnitude according to the manufacturers specification. I_{max} is equal to or greater than I_n .
5. Voltage Protection Level (U_p):
Maximum voltage to be expected at the surge protective device terminals due to an impulse stress with defined voltage steepness and an impulse stress with a discharge current with given amplitude and waveshape.
6. Residual Voltage (U_{res}):
Crest value of voltage that appears between the terminals of an surge protective device due to the passage of discharge current.
7. IEEE 62.41
CATEGORY C: outdoor overhead lines, service entrance (most severe)
CATEGORY B: major feeder, short branch circuits, service panel (indoor)
CATEGORY A: long branch circuits, receptacles (indoor) (least severe)

How to choose a suitable U_c (MCOV) value

Note: $U_c > 1.15U_n$

The relationship between two parameters U_c and U_p of a surge protective device is proportional.

If U_c is small, the value of U_p is also small; surge protective devices with smaller U_p can provide better surge protection.

Whether to choose smaller U_c depends on the voltage stability of the grid.

If you choose surge protective devices with smaller U_c for the grid with instable voltage, the surge protective devices will frequently work while the grid voltage fluctuates, resulting in shortening surge protective device's product life.

If you choose larger U_c , and the value of U_p is accordingly large, the surge protective efficiency will not be so fine.

If you are unsure of the voltage stability of the grid,

it is suggested to calculate MCOV(U_c) using the following formula: $\sqrt{2} U_n < U_c < \sqrt{3} U_n$

AC Network (U_n)	MCOV(U_c), L/N-PE Protection Mode
110V, 120/208V, 127/220V	150V
220/380V	275V, 320V, 385V
230/400V	275V, 320V, 385V, 420V
240/415V	320V, 385V, 420V
266/460V, 277/480V	385V, 420V
347/600V	550V, 690V
Wind Power System	690V (Grid side), 885V (Gen side)

AC Network Connection Diagram (1/2)


1




AC System Voltage

L-N:
110V, 120V, 127V
220V, 230V, 240V
277V, 480V


2P Combination



1P+NPE Combination




2

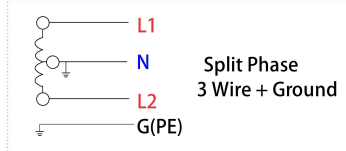


AC System Voltage

L-N/L-L:
120/240V
127/254V
240/480V
277/480V


3P Combination



2P Combination




3

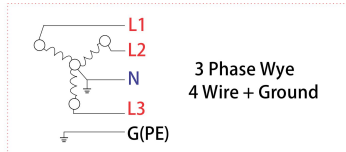


AC System Voltage

L-N/L-L:
120V/208Y
127V/220Y
220V/380Y
230V/400Y
240V/415Y
277V/480Y
347V/600Y


4P Combination



3P+NPE Combination




4

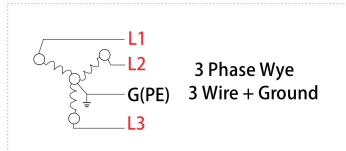


AC System Voltage

L-L:
480V

3P Combination




5

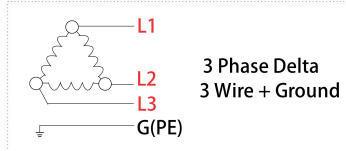

AC System Voltage


L-L:
240V
480V
600V

3P Combination




AC Network Connection Diagram (2/2)

6

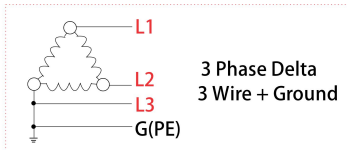


AC System Voltage

L-L:
240V
480V
600V





7

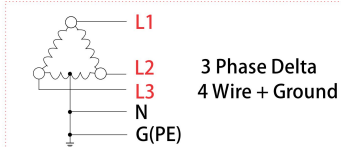


AC System Voltage

L-N/L-L:
120/240V
240/480V





Difference mode & Common mode Connection Diagram

8

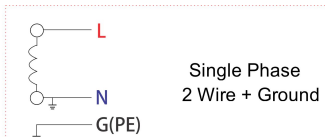

AC System Voltage


L-N:
110V, 120V, 127V
220V, 230V, 240V
277V, 480V




Common mode: L-PE, N-PE surge protection

Difference mode: L-N surge protection

Selection of back-up fuse

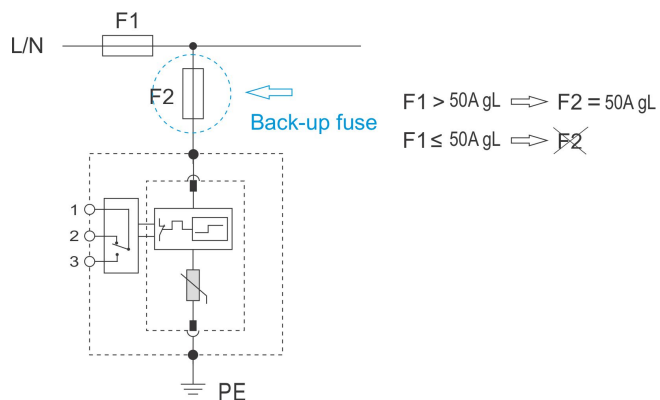

Selection of back-up circuit-breaker

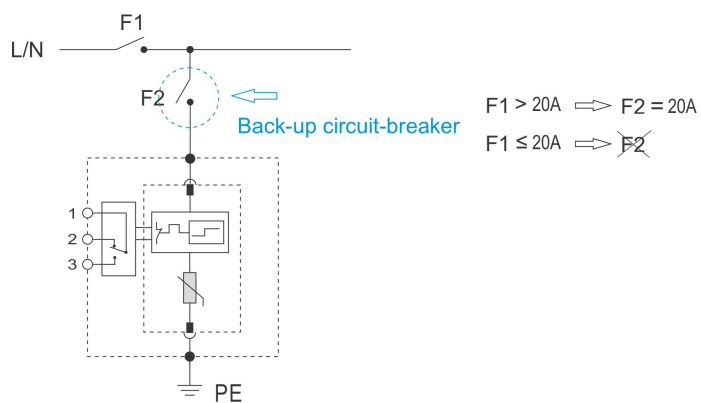

5. Surge protective device, class I or II tested

8. Surge protective device, class II tested

9. Surge protective device, class II or class III tested

IEC62305-4

Installation example of test class I, class II and class III SPDs

1. Origin of the installation
2. Distribution board
3. Distribution outlet
4. Main earthing terminal or bar
5. Surge protective device, class I or II tested
6. Earthing connection (earthing conductor) of the surge protective device
7. Fixed equipment to be protected
8. Surge protective device, class II tested
9. Surge protective device, class II or class III tested
10. Decoupling element or line length

F1, F2, F3 overcurrent protective disconnectors

NOTE Refer to IEC 61643-12 for further information.



Surge Protective Device

N-PE Module

WTH-65/G module integrates High-Energy GDT, no leakage current. It pairs WTH-20/D/R series surge protector, combined into N-PE protection mode, the two modules are the same in dimension and shape, and are connected with a dedicated bus-bar to achieve a perfect combination.

WTH-65/G Technical Data

Max. continuous operating voltage (Uc)	255V
Nominal Discharge Current (In)	25kA
Max. Discharge Current (Imax)	65kA
Pulsed Current (Iimp)	15kA
Voltage protection level (Up)	1.0kV
Protection Modes	N-PE only
Protective Element	High Energy GDT
Follow Current (If)	100A rms
Response Time (tA)	<100ns
Net Weight Per Unit	0.24Lb (109g)

3P + NPE Combintion Package

Model with suffix	Ordering Code	Model with suffix	Ordering Code
WTH-20/D/R/1P-275 x3pcs +NPE	US220194x3N	WTH-20/D/1P-275 x3pcs +NPE	US220184x3N
WTH-20/D/R/1P-320 x3pcs +NPE	US220195x3N	WTH-20/D/1P-320 x3pcs +NPE	US220185x3N
WTH-20/D/R/1P-385 x3pcs +NPE	US220196x3N	WTH-20/D/1P-385 x3pcs +NPE	US220186x3N
WTH-20/D/R/1P-420 x3pcs +NPE	US220197x3N	WTH-20/D/1P-420 x3pcs +NPE	US220187x3N

1P + NPE Combintion Package

Model with suffix	Ordering Code	Model with suffix	Ordering Code
WTH-20/D/R/1P-275 +NPE	US220194x1N	WTH-20/D/1P-275 +NPE	US220184x1N
WTH-20/D/R/1P-320 +NPE	US220195x1N	WTH-20/D/1P-320 +NPE	US220185x1N
WTH-20/D/R/1P-385 +NPE	US220196x1N	WTH-20/D/1P-385 +NPE	US220186x1N
WTH-20/D/R/1P-420 +NPE	US220197x1N	WTH-20/D/1P-420 +NPE	US220187x1N



Surge Protective Device

FAQ & Help

1. What should I do if I can't find the paper manual in the product packaging?

Watchful Eye products is committed to going green with paperless data sheets. On the side of each product enclosure is an engraved link with URL for downloading paperless data sheet and QR code of the website. If you need the paper data sheet, you can open the link and print the data sheet by yourself.

2. The advantages of fault indication windows?

If surge protection fails, the fault indication windows will turn red, thus it can be seen intuitively, and the surge protective device can be replaced in time to avoid damage to the equipment caused by a second surge.

3. What instruments can be used to test whether its surge protection function is normal or not?

Test with a Watchful Eye surge protector tester

4. How to connections of the SPD?

Please refer to the standard IEC 60364-5-53

Connecting conductors of SPDs:

Conductors between the SPD and the main earthing terminal or the protective conductor shall have a cross-sectional area not less than: - 6 mm² copper or equivalent for class II tested SPDs installed at or near the origin of the installation;

- 16 mm² copper or equivalent for class I tested SPDs installed at or near the origin of the installation.

a) L/N to surge protector copper recommended diameter: 7AWG (10mm²), minimum: 6mm²

b) surge protector to PE copper recommended diameter: 5AWG (16mm²), minimum: 10mm²

(a+b) ≤ 0.5m

5. Can you list more applications?

Power supply panel, whole house



Surge Protective Device

Download WatchfulEyE Official App

To learn about more products and updates from company, please scan QR code to download the official App:



After-sale Services

Watchful Eye provides a 5-year quality warranty globally.

[I have a question](#)