



Surge Protective Device

WTH-250/GM/R Series	
Paperless Datasheet	01
Model & Ordering Code	01
Certificates of Products	01
More Package	02
Technical Data	03
Surge Protection Connection Diagram	04
Dimensions	04
Remote Contacts (Dry Contacts)	05
Fault Indication	05
Common Terms and Definitions	06
How to choose a suitable Uc(MCOV) value	06
AC Network Connection Diagram	07
Difference mode & Common mode Connection Diagram	08
Selection of back-up fuse	09
Selection of back-up circuit-breaker	09
Application	10
FAQ & Help	11
Download WatchfulEyE Official App	12
After-sale Services	12
I have a question	12



Surge Protective Device

More Package

Model with suffix	WTH-250/GM/R/1P-275	x2pcs	x3pcs	x4pcs
Ordering Code	US229202	US229202x2	US229202x3	US229202x4

Model with suffix	WTH-250/GM/R/1P-320	x2pcs	x3pcs	x4pcs
Ordering Code	US229203	US229203x2	US229203x3	US229203x4

Model with suffix	WTH-250/GM/R/1P-385	x2pcs	x3pcs	x4pcs
Ordering Code	US229204	US229204x2	US229204x3	US229204x4

Model with suffix	WTH-250/GM/R/1P-420	x2pcs	x3pcs	x4pcs
Ordering Code	US229205	US229205x2	US229205x3	US229205x4



Surge Protective Device


Description

In accordance with: IEC/EN61643-11 - Class I+II and UL1449 Type 4 Location
Location of use: main sub-distribution boards, branch sub-distribution boards
Built-in 3-layer High Energy GDT+MOV: Safely applied to L-PE mode to realize Class I surge protection.
Plug-in module and separate base design enables convenient maintenance.
Internal thermal disconnect devices help ensure safe or at end-of-life

WTH-250/GM/R/1P Series Technical Data


Requirement Class to IEC/EN61643-11	Class I+II
IEEE Category Rating	C, B & A
Nominal Discharge Current (In)	30kA
Max. Discharge Current (Imax)	65kA
Pulsed Current (Iimp)	25kA
Protection Modes	L-PE, N-PE
Protective Element	3-layer High Energy GDT+MOV
Follow Current (If)	3kA
Response Time (tA)	<5ns
Leakage Current (at 75%U1mA)	<20μA
Thermal Protection	YES
Protection Rating (IP Code)	IP 20
Short Circuit Current Ratings (SCCR)	25kA rms
Max. Back-up Fuse (if mains >125A)	125A gL (circuit-breaker: <63A)
Surge Life at 3kA (8/20μs)	>5000 events
Temperature Range	- 40°F to 176°F (-40°C to 80°C)
Relative Humidity	0% to 95% noncondensing
Maximum Operating Altitude	10,000 feet (3000m)
Terminal Cross Section	35mm ² (solid) / 25mm ² (stranded)
Stripping Length Contacts	0.6inches (15mm)
Terminal Screw Torque	Max. 3.5Nm
DIN Rail EN60715	35mm top-hat rail
Dimensions DIN 43880	36mm (2TE)
Housing Material	Thermoplastic (UL94 V-0)
Housing Design	Modular design
Net Weight Per Unit	0.5Lb (227g)

Surge Protection Connection Diagram

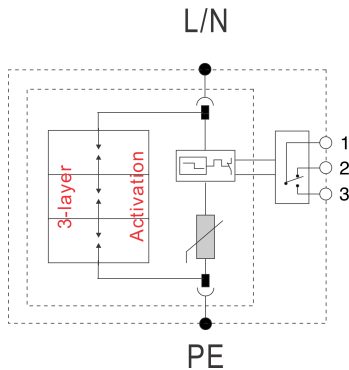

Maximum Continuous Operating Voltage (MCOV/Uc)	275VAC	320VAC	385VAC	420VAC
Voltage Protection Level (Up)	1.7kV	1.9kV	2.0kV	2.2kV
Residual Voltage (Ures)	1.0kV	1.1kV	1.2kV	1.4kV


Dimensions

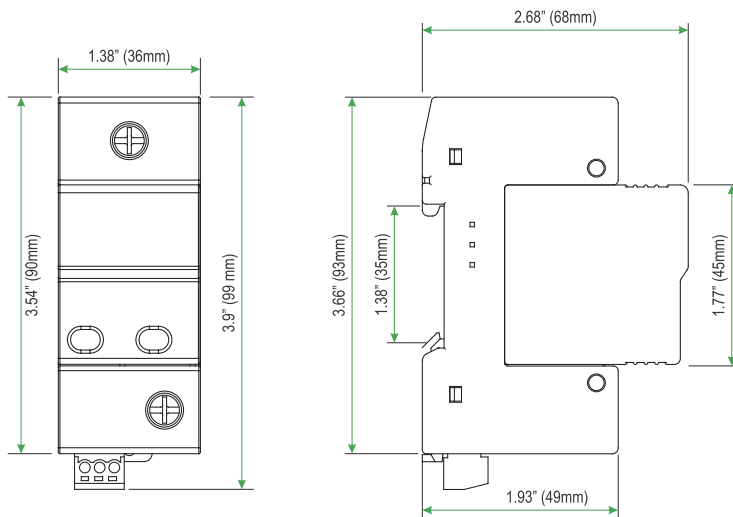

Surge Protective Device


Remote Contacts (Dry Contacts)

- 1: COM (Common)
- 2: NC (Normally Close)
- 3: NO (Normally Open)

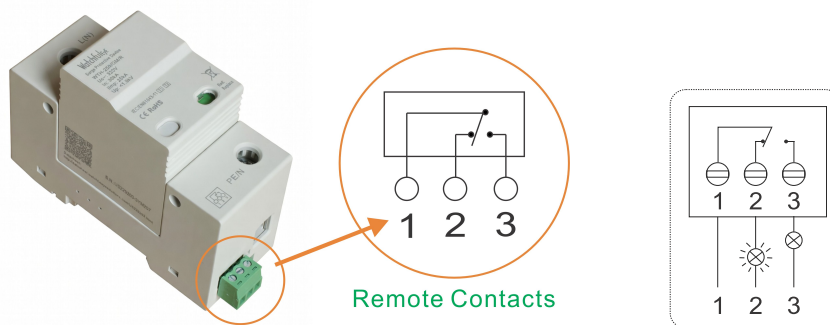

Contact Ratings	125VAC/3A, 250VAC/1.5A
Terminal Cross Section	Max. 1.5mm ²
Stripping Length Contacts	0.25 inches (6-7mm)
Remote Terminal Torque	0.25Nm

Fault Indication

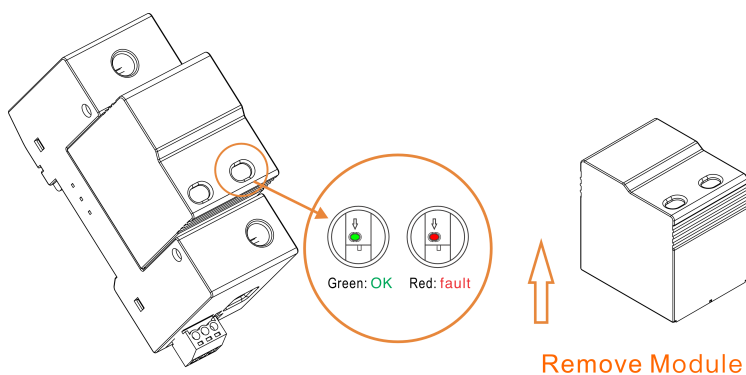

Common Terms and Definitions

1. Normal operating voltage rating (U_n)

2. Maximum Continuous Operating Voltage (U_c /MCOV):

Maximum r.m.s. voltage, which may be continuously applied to the surge protective device's mode of protection.

3. Nominal Discharge Current for Class II Test (I_n):

crest value of the current through the surge protective device having a current waveshape of 8/20 μ s.

4. Maximum Discharge Current (I_{max}):

Crest value of a current through the surge protective device having an 8/20 μ s waveshape and magnitude according to the manufacturers specification. I_{max} is equal to or greater than I_n .

5. Voltage Protection Level (U_p):

Maximum voltage to be expected at the surge protective device terminals due to an impulse stress with defined voltage steepness and an impulse stress with a discharge current with given amplitude and waveshape.

6. Residual Voltage (U_{res}):

Crest value of voltage that appears between the terminals of an surge protective device due to the passage of discharge current.

7. IEEE 62.41

CATEGORY C: outdoor overhead lines, service entrance (most severe)

CATEGORY B: major feeder, short branch circuits, service panel (indoor)

CATEGORY A: long branch circuits, receptacles (indoor) (least severe)

How to choose a suitable U_c (MCOV) value

Note: $U_c > 1.15U_n$

The relationship between two parameters U_c and U_p of a surge protective device is proportional.

If U_c is small, the value of U_p is also small; surge protective devices with smaller U_p can provide better surge protection.

Whether to choose smaller U_c depends on the voltage stability of the grid.

If you choose surge protective devices with smaller U_c for the grid with instable voltage, the surge protective devices will frequently work while the grid voltage fluctuates, resulting in shortening surge protective device's product life.

If you choose larger U_c , and the value of U_p is accordingly large, the surge protective efficiency will not be so fine.

If you are unsure of the voltage stability of the grid,

it is suggested to calculate MCOV(U_c) using the following formula: $\sqrt{2} U_n < U_c < \sqrt{3} U_n$

AC Network (U_n)	MCOV(U_c), L/N-PE Protection Mode
110V, 120/208V, 127/220V	150V
220/380V	275V, 320V, 385V
230/400V	275V, 320V, 385V, 420V
240/415V	320V, 385V, 420V
266/460V, 277/480V	385V, 420V
347/600V	550V, 690V
Wind Power System	690V (Grid side), 885V (Gen side)

AC Network Connection Diagram (1/2)


1




AC System Voltage

L-N:
110V, 120V, 127V
220V, 230V, 240V
277V, 480V


2P Combination



1P+NPE Combination




2

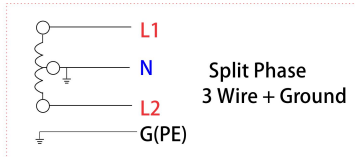


AC System Voltage

L-N/L-L:
120/240V
127/254V
240/480V
277/480V


3P Combination



2P Combination




3

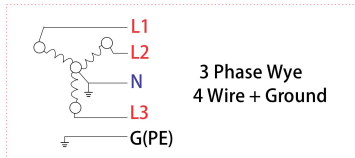


AC System Voltage

L-N/L-L:
120V/208Y
127V/220Y
220V/380Y
230V/400Y
240V/415Y
277V/480Y
347V/600Y


4P Combination



3P+NPE Combination




4

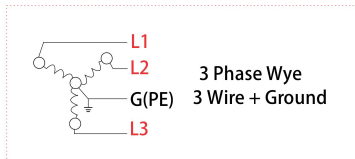


AC System Voltage

L-L:
480V

3P Combination




5

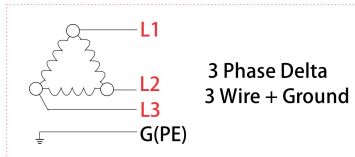

AC System Voltage


L-L:
240V
480V
600V

3P Combination




AC Network Connection Diagram (2/2)

6

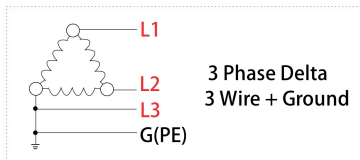


AC System Voltage

L-L:
240V
480V
600V





7

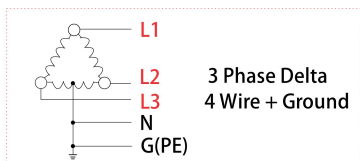


AC System Voltage

L-N/L-L:
120/240V
240/480V





Difference mode & Common mode Connection Diagram

8

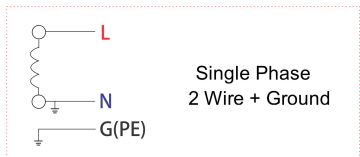

AC System Voltage


L-N:
110V, 120V, 127V
220V, 230V, 240V
277V, 480V




Common mode: L-PE, N-PE surge protection

Difference mode: L-N surge protection

Selection of back-up fuse

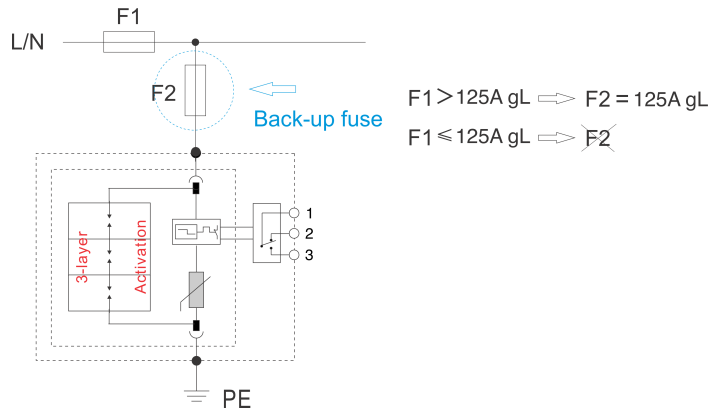


Selection of back-up circuit-breaker

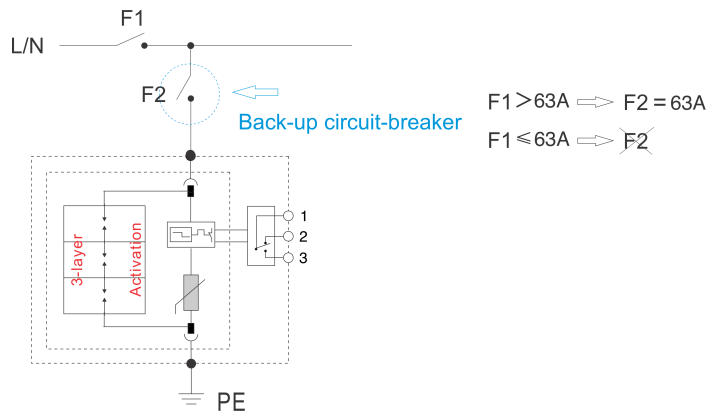

Surge Protective Device

Application

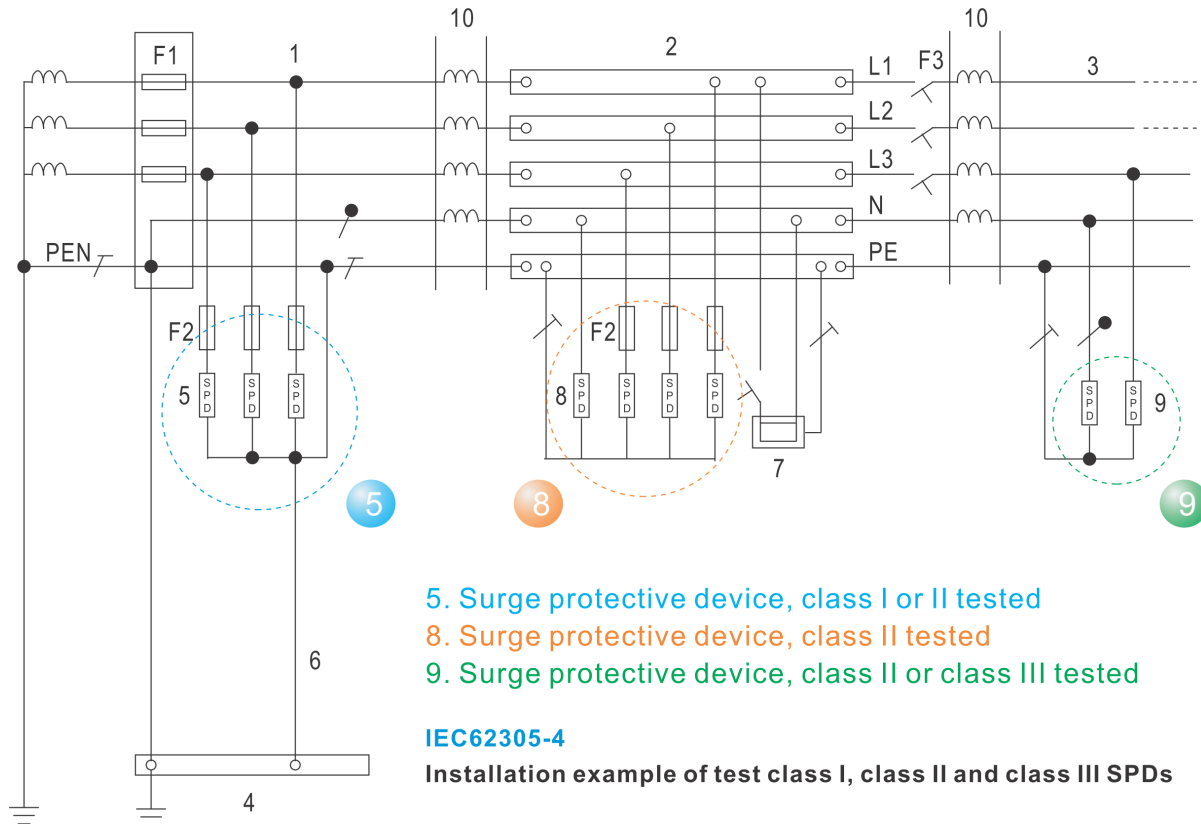

Key

1. Origin of the installation
 2. Distribution board
 3. Distribution outlet
 4. Main earthing terminal or bar
 5. Surge protective device, class I or II tested
 6. Earthing connection (earthing conductor) of the surge protective device
 7. Fixed equipment to be protected
 8. Surge protective device, class II tested
 9. Surge protective device, class II or class III tested
 10. Decoupling element or line length
- F1, F2, F3 overcurrent protective disconnectors
- NOTE Refer to IEC 61643-12 for further information.



Surge Protective Device

FAQ & Help

1. What should I do if I can't find the paper manual in the product packaging?

Watchful Eye products is committed to going green with paperless data sheets. On the side of each product enclosure is an engraved link with URL for downloading paperless data sheet and QR code of the website. If you need the paper data sheet, you can open the link and print the data sheet by yourself.

2. The advantages of fault indication windows?

If surge protection fails, the fault indication windows will turn red, thus it can be seen intuitively, and the surge protective device can be replaced in time to avoid damage to the equipment caused by a second surge.

3. What instruments can be used to test whether its surge protection function is normal or not?

Test with a Watchful Eye surge protector tester

4. Can you list more applications?

Power supply panel, whole house

5. What is the feature of Class I+II?

It provides high capability of Class I surge protection, and capability of Class II (equivalent to the parameters of WTH-50) fine protection with low residual voltage as well, applying to Class I and Class II surge protection in multiple areas. If you are not sure which module to choose for protecting your area, Class I + II is the best solution.



Surge Protective Device

Download WatchfulEye Official App

To learn about more products and updates from company, please scan QR code to download the official App:



After-sale Services

Watchful Eye provides a 5-year quality warranty globally.

[I have a question](#)